

Cal. VX3JA

φ 23.3 mm Η 3.05 mm

Items	Rev.	Page
Specifications	01	1
Appearance	07	2
Casing	07	3
Hand fitting	10	4
Hand setting stem	04	5
Dial	04	6
Casing ring	02	7

Date: 17/Jul./'12

S.EPSON Products

Date : 31/May/'06 Rev. : 01

MOVEMENT SPECIFICATIONS

CAL. VX3JA

Analog Quartz 10 1/2" Slim Movement / 3 hands (H/M/S) and 3 eyes with Day / Date / 24Hour indicators

1. MOVEMENT DIMENSIONS

Outside diameter	ϕ 24.00mm × 21.50mm(3-9H) × 21.50mm(12-6H)
Casing diameter	ϕ 23.30mm × 21.30mm(3-9H) × 21.50mm(12-6H)
Total height	3.05mm (including battery)

2. TIME STANDARD

Type of quartz oscillator	Tuning fork
Frequency of quartz oscillator	32,768 Hz
Accuracy	± 20 seconds per month (on wrist)
Operating temperature range	-5° C to $+50^{\circ}$ C
Regulation device	Nil (Pre-adjusted)

3. INDICATOR / FUNCTIONS

3 Hands	Hour / Minute / Second
3 Small hands	Day / Date / 24Hour
Reset switch	
Setting mechanism	Crown at normal position : Free
	Crown pulled out 1st click : Instant date change
	Crown pulled out 2nd click : Time setting (Day change) / Reset

4. FEATURES

Jewels	1 Jewel
Anti-magnetism	Over 1600A/m (Direct current magnetic field)
Maximum unbalance of hands	Second hand : 6 mg·mm
	Minute hand : 65 mg·mm

5. BATTERY

Type / Size	Silver oxide battery / ϕ 9.5mm × t 1.6mm
Recommended battery	SR916SW (Maxell, Panasonic, Sony, Seizaiken)
Nominal voltage	1.55 V
Battery life	Approx. 3 years
Driving current consumption	Approx. 0.85 μ A
Operation stopping voltage	0.9 V


6. SEPARATED PARTS (Parts code)


Hand setting stem	0354531 or 0354534
Battery	SR916SW


7. TEST OF ACCURACY

Equipment to be used	SEIKO quartz tester QT-99,
	Greiner quartz timer-C, Witschi Q-tester 4000
Duration of measurement	10 seconds
Microphone to be used	Electromagnetic detection type


All specifications are subject to change without notice.

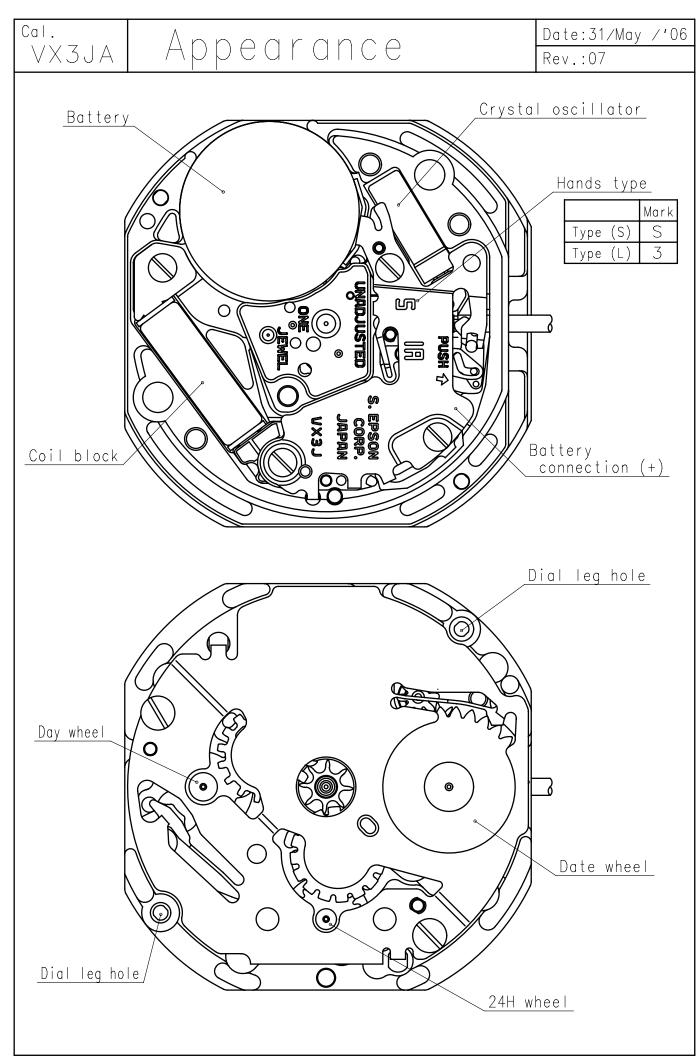


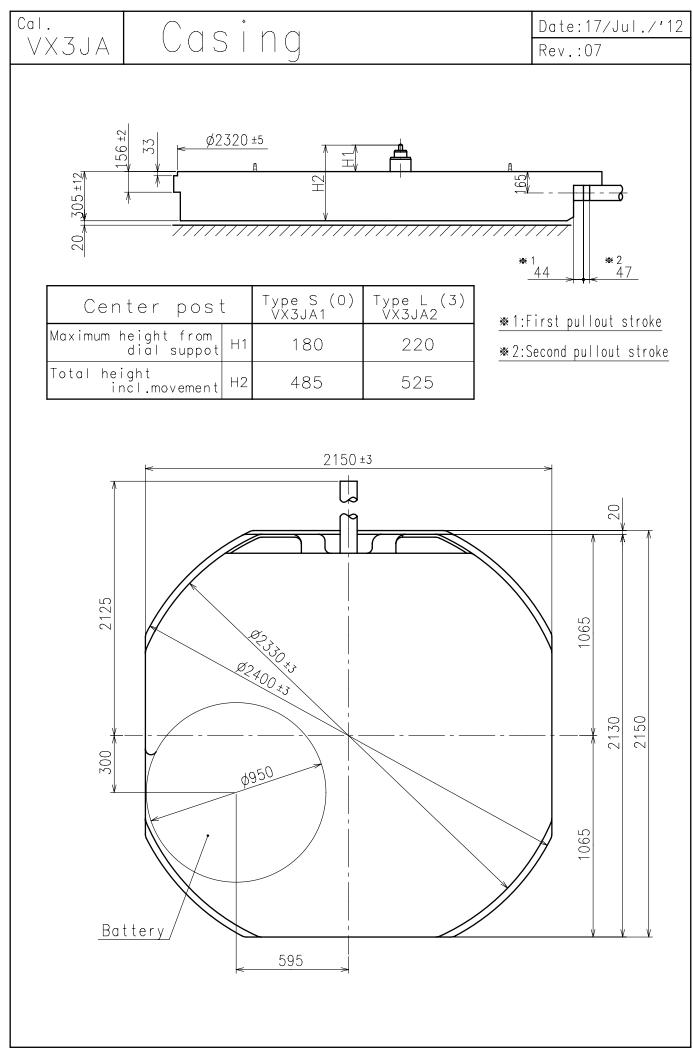

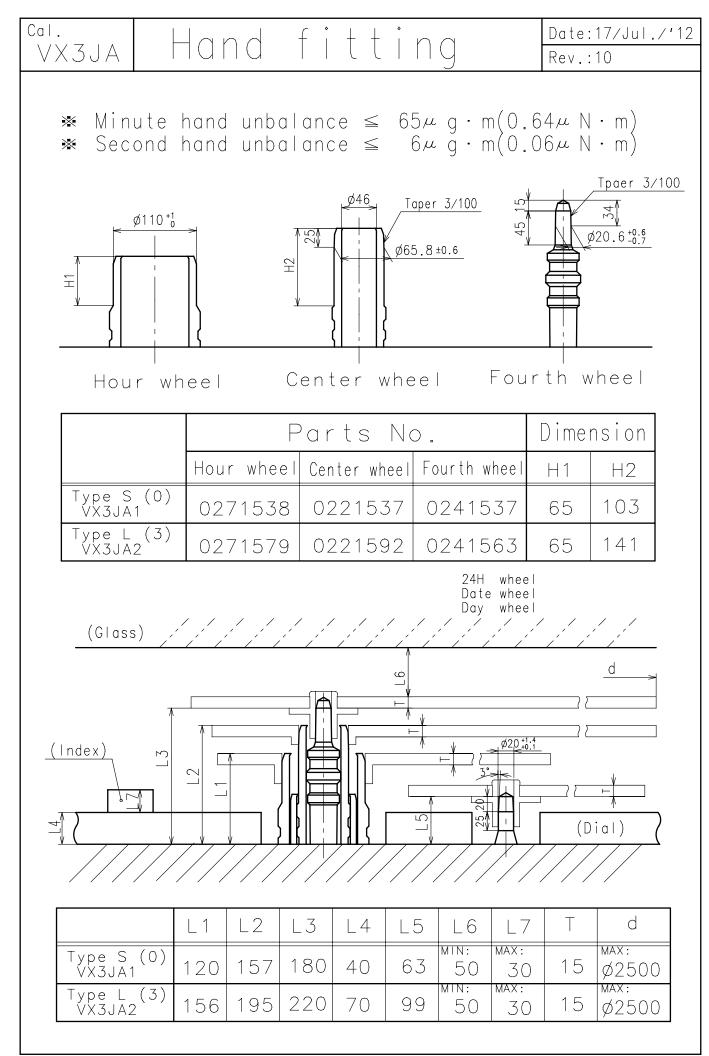


Unit : 1=1/100mm

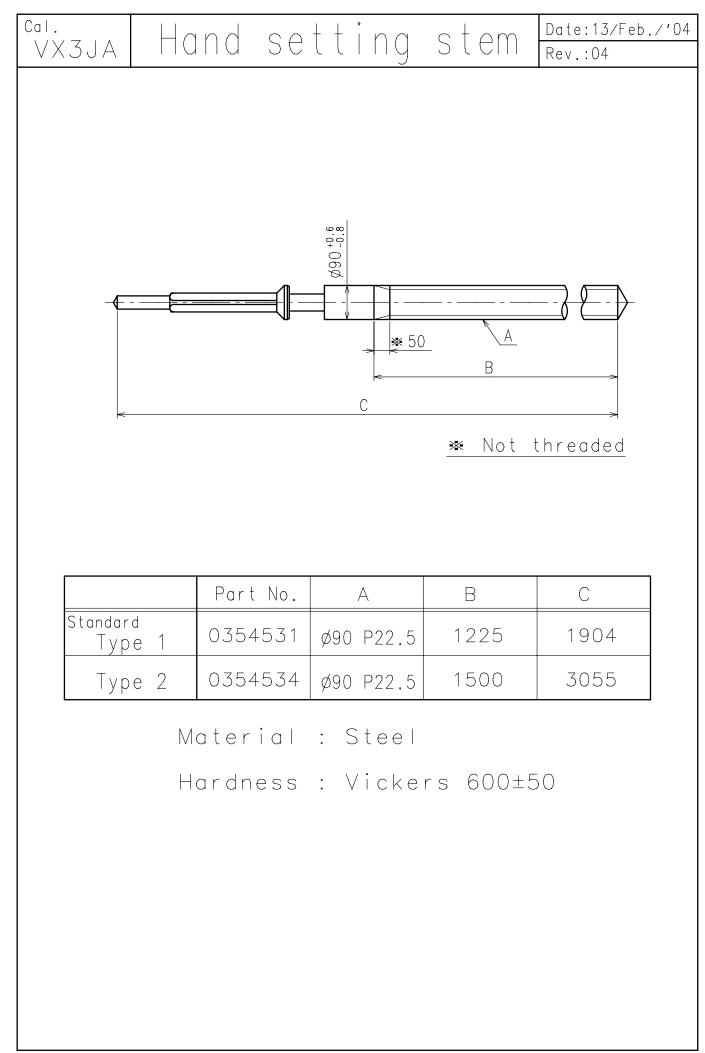

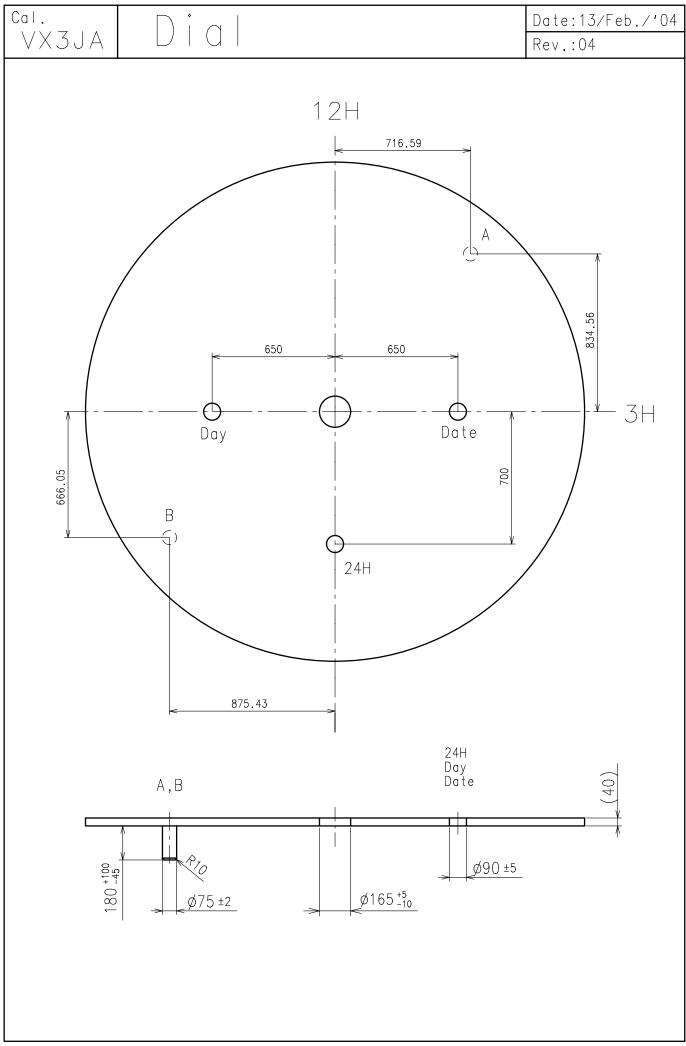

Unit : 1=1/100mm

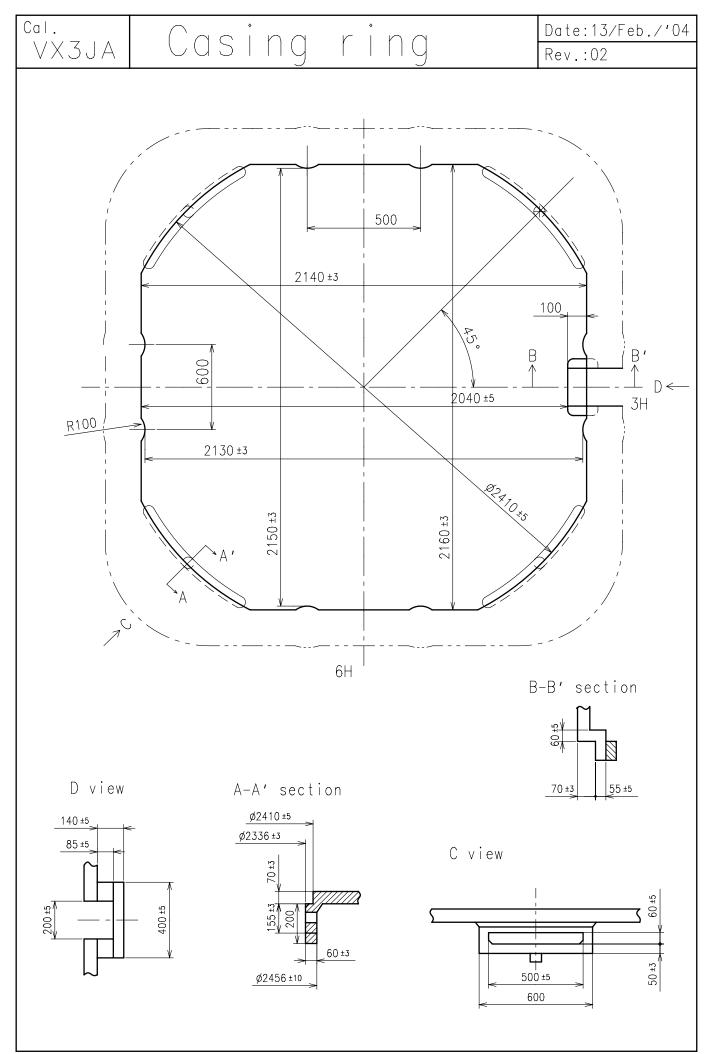

Unit : 1=1/100mm